2013
CA MECHANICAL CODE
802.8

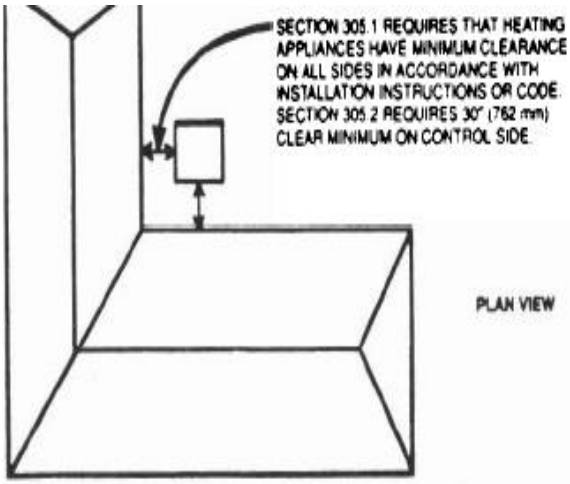

ACCESS TO APPLIANCE FOR INSPECTION, SERVICE OR REPAIR

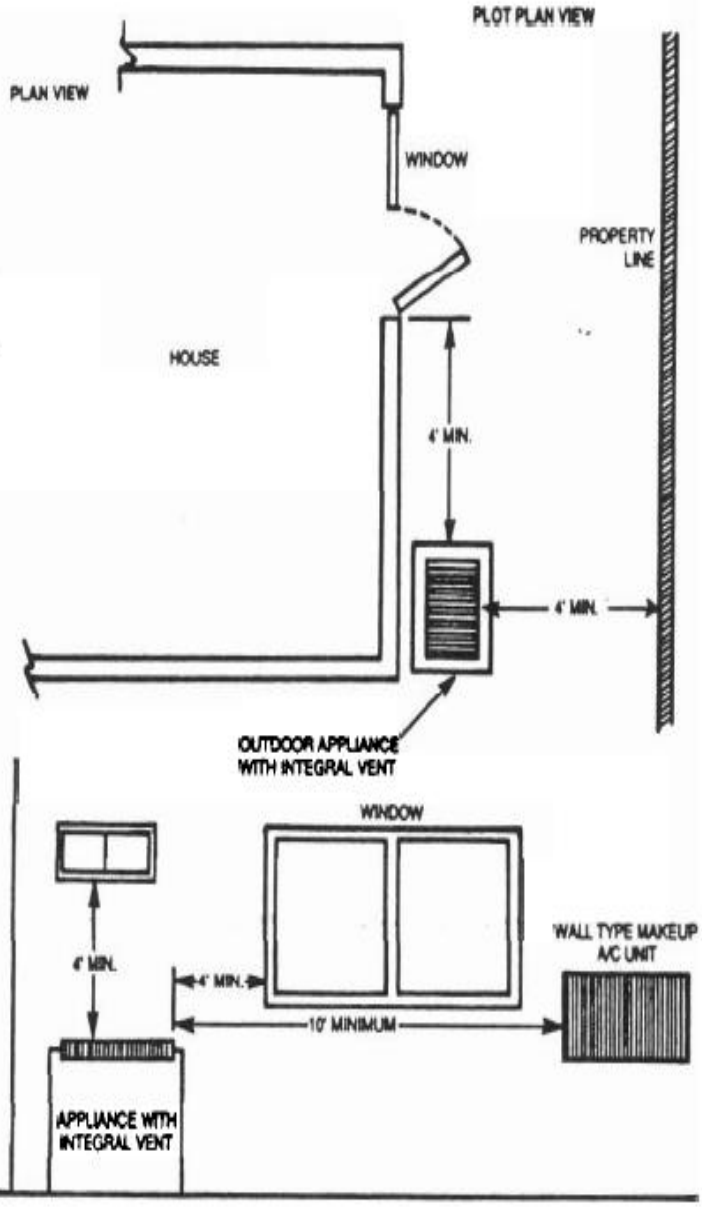

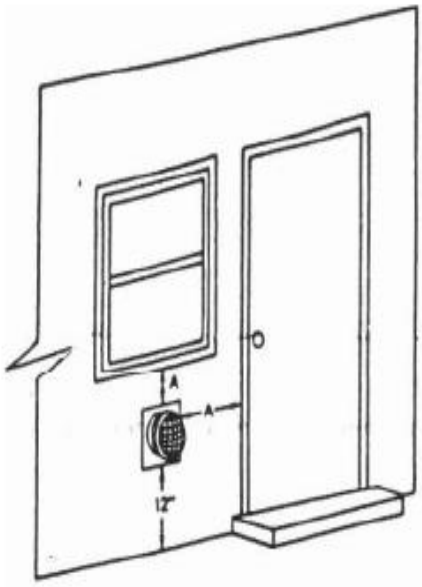

	A
APPLIANCES 50,000 BTU OR LESS	9"
OVER 50,000 BTU BUT NOT EXCEEDING 65,000 BTU	12"

OUTDOOR VENT TERMINATION—APPLIANCES WITH INTEGRAL VENTS